

Thank You

Thanks for purchasing an RPX resistive chain continuous level probe from us! We appreciate your business and your trust. Please take a moment to familiarize yourself with the product and this manual before installation. If you have any questions, at any time, don't hesitate to call us at 888-525-7300. You can also find a full list of our product manuals at: www.apgsensors.com/resources/product-resources/user-manuals

Table of Contents

1. Description	5. Mounting and Installation Instructions	8. Offset and Span Calibration
2. How To Read Your Label	6. Terminal Tables	9. General Care
3. Warranty	7. Removal Instructions	10. Repair Information
4. Dimensions	11. Hazardous Location Wiring	

1 Description

The RPX resistive probes contain reed switches in a 1/2" Ø stainless steel stem and a permanent magnet in a float. As the float rises or falls with the level of the liquid, the magnet inside the float acts on the corresponding reed switches inside the stem, changing the output of the probe. The RPX carries explosion proof, intrinsically safe, and non-incendive hazardous location approvals.

2 How To Read Your Label

Each label comes with a full model number, a part number, and a serial number. The model number for the RPX will look something like this:

▲ SAMPLE: RPX-A-P2W-S6-E-48.00


The model number correlates with all the configurable options and tells you exactly what you have. Compare the model number to the options on the datasheet to identify your exact configuration. You can also call us with the model, part, or the serial number, and we can help you.

You'll also find all hazardous certification information on the label.

3 Warranty

This product is covered by APG's warranty to be free from defects in material and workmanship under normal use and service of the product for 24 months. For a full explanation of our Warranty, please visit www.apgsensors.com/resources/warranty-certifications/warranty-returns/. Contact Technical Support to receive a Return Material Authorization before shipping your product back.

4 Dimensions

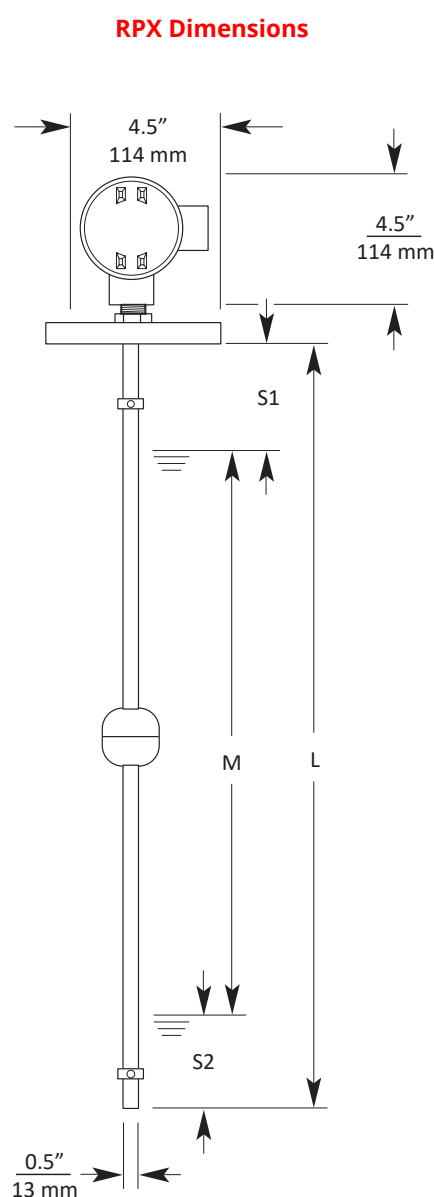

RPX Continuous Level Probe Installation Guide

For RPX Series



Automation Products Group, Inc.
1025 W 1700 N Logan, UT 84321
www.apgsensors.com | phone: 888-525-7300 | email: sales@apgsensors.com

Part # 200853
Doc # 9006503 Rev B

5 Mounting and Installation Instructions

Mounting Instructions:

- Flange Mounting: Provide the compatible mating flange on the tank and install using a suitable gasket.
- Plug Mounting: Provide the compatible female boss on the tank and install the probe with thread tape.

Additional care must be taken to ensure:

- The sensor is located away from strong magnetic fields, such as those produced by motors, transformers, solenoid valves, etc.
- The medium is free from metallic substances and other foreign matter.
- The sensor is not exposed to excessive vibration.

Installation Notes:

- Do not locate your RPX series level sensor near inlets/outlets.
- If there is surface wave action, then use a time-delay relay or stilling tube. If a stilling tube is used, drill vent holes in the tube and use a spacer to assure the float has free travel inside the tube (See Figure 5.1).
- The RPX can be mounted up to 20° from vertical.

IMPORTANT: Your RPX MUST be installed according to drawing 9001930 (IS Hazardous Installation Drawing For RPX) or 9001932 (Hazardous Mounting Drawing RPX) to meet listed approvals. Faulty installation will invalidate all safety approvals and ratings.

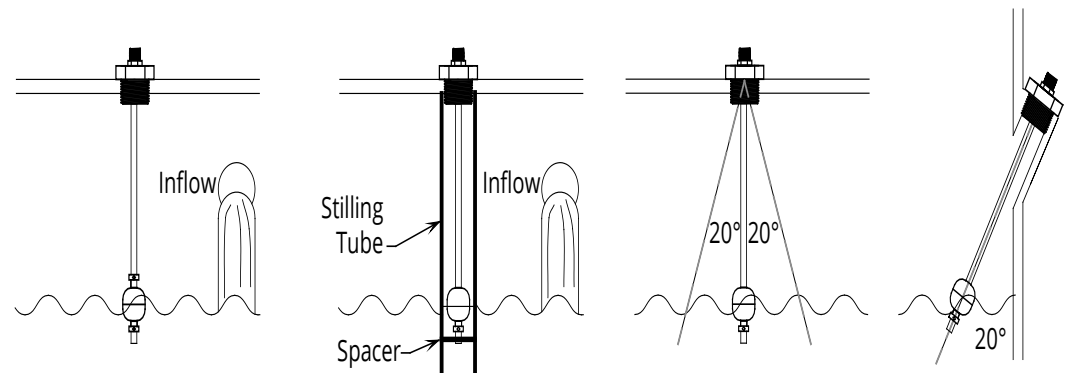


Figure 5.1

DANGER: Do not remove the housing cover until the atmosphere is determined safe, and the power supply is turned off.

Electrical Installation Instructions:

- Install conduit and/or cable with necessary seal(s) per Drawing 9001930 or 9001932 for hazardous locations.
- Remove the housing cover.
- Check the Terminal Tables in section 6 before making any connections.
- Connect the wire for your system to the appropriate terminal.
- Replace the housing cover.

6 Terminal Tables

Terminals for RPX-A and RPX-I

	Black (Internal)
	White (Internal)
	Red (Internal)
	Output
	+24 VDC

Terminals for RPX-R (Resistive Output)

Output		White (Internal)
Ground		Black (Internal)
VDC Supply		Red (Internal)

7 Removal Instructions

Removing your RPX from service must be done with care. It's easy to create an unsafe situation, or damage your sensor, if you are not careful to follow these guidelines:

- Ensure all circuits are de-energized, and any hazardous atmosphere has dispersed.
- Disconnect wires, either at terminals in the RPX head or at your system.
- Remove the RPX with an appropriately sized wrench (per your mounting type).
- Clean the RPX's stem and float of any debris (see General Care) and inspect for damage.
- Store your RPX in a dry place, at a temperature between -40° and 85°C (-40° and 185°F).

8 Offset and Span Calibration (4-20 mA output probes only)

This procedure can be performed in a non-hazardous area, either prior to installation, or by temporarily uninstalling your 4-20 mA RPX probe:

- Set DC power supply to 24 VDC, and connect to the RPX probe, with ammeter in loop.
- Move float to the desired position for 4 mA output.
- Using a jeweler's screwdriver or a suitable instrument, adjust the "Offset" potentiometer until you have a 4 mA output.
- Move float to the desired position for 20 mA output.
- Using a jeweler's screwdriver or a suitable instrument, adjust the "Span" potentiometer until you have a 20 mA output.
- Repeat as necessary to fine tune calibration. (See Figure 8.1)
- Replace the housing cover when finished.

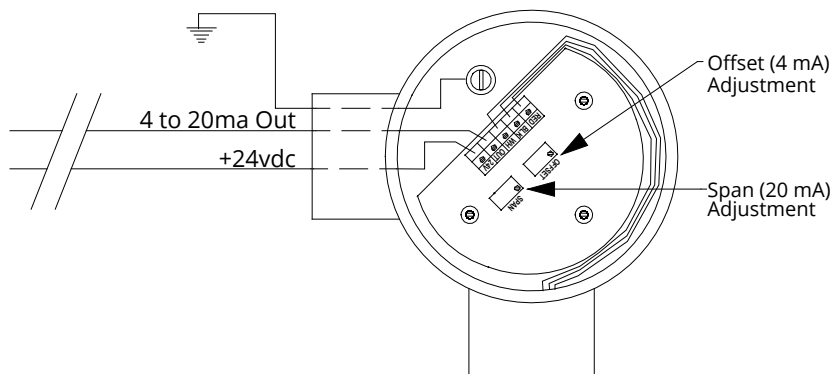


Figure 8.1

NOTE: This procedure can be performed in a non-hazardous area, either prior to installation, or by temporarily uninstalling your 4-20 mA RPX probe.

NOTE: You may also return the RPX probe to the factory for repair and/or adjustment.

9 General Care

Your RPX resistive chain continuous level probe is very low maintenance and will need little care as long as it is installed correctly. However, in general, you should:

- Periodically inspect the stem and floats for any trapped debris, sediment, or other foreign material.
- Avoid applications for which the RPX was not designed, such as extreme temperatures, contact with incompatible corrosive chemicals, or other damaging environments.
- If your RPX has an NPT mount, inspect the threads whenever you remove it from duty or change its location.
- Never leave the housing cover off. If the cover is damaged or lost, order a replacement immediately.

10 Repair Information

Should your RPX require service, please contact us via email, phone, or online chat on our website. We will issue you an RMA number with instructions.

- Phone: 888-525-7300
- Email: sales@apgsensors.com
- Online chat at www.apgsensors.com

WARNING: SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC SAFETY; AVERTISSEMENT -- LA SUBSTITUTION DE COMPOSANTS PEUT COMPROMETTRE LA SECURITE INTRINSEQUE.

DANGER: OPEN CIRCUIT BEFORE REMOVING COVER or KEEP COVER TIGHT WHILE CIRCUITS ARE ALIVE; AVERTISSEMENT -- COUPER LE COURANT AVANT D'ENLEVER LE COUVERCLE, ou GARDER LE COUVERCLE FERME TANT QUE LES CIRCUITS SONT SOUS TENSION.

DANGER: EXPLOSION HAZARD-DO NOT DISCONNECT WHILE CIRCUIT IS LIVE UNLESS AREA IS KNOWN TO BE NON-HAZARDOUS; AVERTISSEMENT -- RISQUE D'EXPLOSION. NE PAS DEBRANCHER TANT QUE LE CIRCUIT EST SOUS TENSION, A MOINS QU'IL NE S'AGISSE D'UN EMPLACEMENT NON DANGEREUX.

IMPORTANT: SEAL SHALL BE INSTALLED WITHIN 50 mm OF THE ENCLOSURE; IMPORTANT -- UNSCELLEMENT DOIT ETRE INSTALLE A MOINS DE 50 mm DU BOITIER.

11 Hazardous Location Wiring

IS Hazardous Installation Drawing

REVISIONS					
ZONE	REV	DESCRIPTION	CHANGE ORDER	DATE	APPROVED
-	C1	Change to APG Title Block	CO-	1471	7/20/09 K. Reid

Installation in Class I Division 1 Groups C and D
RPX Resistive Probe (4-20ma Loop Powered)

NON-HAZARDOUS AREA
Circuit Diagram 1
Dual Channel Safety Barrier

HAZARDOUS AREA

Circuit Diagram for Supply and Return Safety Barriers

HAZARDOUS AREA

- Install in accordance with CEC, NEC articles 504, 505 and ISA RP12.6 Recommended Practice for the Installation of Intrinsically Safe Circuits.
- WARNING: SUBSTITUTION OF COMPONENTS MAY IMPAIR INTRINSIC SAFETY (AVERTISSEMENT: LA SUBSTITUTION DE COMPOSANTS PEUT COMPROMETTRE LA SECURITE INTRINSEQUE).
- WARNING: EXPLOSION HAZARD - DO NOT DISCONNECT EQUIPMENT UNLESS POWER HAS BEEN SWITCHED OFF OR AREA IS KNOWN TO BE NONHAZARDOUS (AVERTISSEMENT - DE DECONNECTER L'EQUIPMENT; COUPER LE COURANT DU S' ASSURER QUE L'EMPLACEMENT EST DESIGNÉ NON DANGEREUX).

PROPRIETARY AND CONFIDENTIAL
THIS DRAWING IS THE PROPERTY OF
AUTOMATION PRODUCTS GROUP, INC.
LOGAN, UTAH AND MAY NOT BE
USED, REPRODUCED, PUBLISHED, OR
DISCLOSED TO OTHERS WITHOUT
WRITTEN CONSENT OF THE COMPANY.
IF LOANED, IT IS SUBJECT TO RETURN
UPON DEMAND AND MAY NOT BE USED
IN ANY WAY DIRECTLY OR INDIRECTLY
DETRIMENTAL TO THE COMPANY.

UNLESS OTHERWISE SPECIFIED
DIMENSIONS ARE IN INCHES
AND TOLERANCES ARE AS FOLLOWS:
TOLERANCE ON ANGLE: ±1°
2 PLACES: ±.01"
3 PLACES: ±.005"
INTERPRET DIMENSIONS AND TOLERANCES
PER ASME Y14.5M 1994 (R1999)

APPROVALS	DATE
DRWN K. Reid	10/10/02
CHKD D. Hutchins	10/10/02
APVD K. REID	10/10/2002

CONTRACT	SIZE	CAGE CODE	PART NO	DOCUMENT NO	REV
MATL N/A	C	OZ430	RPX_IS_HM	9001930	C1
FINISH N/A	SCALE	NONE	DO NOT SCALE DRAWING	SHEET 1 OF 1	

APGH 1025 West 1700 North
Automation Products Group, Inc. Logan, Utah USA
888.525.7300

IS Hazardous Installation Drawing
for RPX Resistive Chain Probe
(RPX_IS_HM)

Hazardous Mounting Drawing

REVISIONS					
ZONE	REV	DESCRIPTION	CHANGE ORDER	DATE	APPROVED
-	C2	Add Zone Listing	CO-	1961	11/04/13 K. Reid

Installation in Class I Division 2 Groups C and D, Max. Temp. 85°C
Installation in Class I Division 1 Groups C and D, Max. Temp. 40°C
Installation in Class I Zone 1; Ex d IIB / AEx d IIB T3

HAZARDOUS AREA **NON-HAZARDOUS AREA**

Mount probe by clamping securely into place Or use mounting flange or mounting thread if provided.

Mount probe by clamping securely into place Or use mounting flange or mounting thread if provided.

- Install in accordance with Section 18 of the CEC or Article 500 of the NEC.
- CSA listed or NRTL/UL listed conduit seal at location A & B.
- DO NOT DISCONNECT WHILE CIRCUIT IS ALIVE UNLESS AREA IS KNOWN TO BE NON-HAZARDOUS
- Tampering or replacement with non-factory components may adversely affect the safe use of the system.

Non-Incendive Wiring for Installation in
Class I Division 2 Groups C and D, Max. Temp. 85°C

NON-HAZARDOUS AREA

Certified Associated
Non-Incendive
Field wiring Apparatus

HAZARDOUS AREA

- Vmax ≥ Voc,
Ca ≥ Ccable + Ci
La ≥ Lcable + Li

PROPRIETARY AND CONFIDENTIAL
THIS DRAWING IS THE PROPERTY OF
AUTOMATION PRODUCTS GROUP, INC.
LOGAN, UTAH AND MAY NOT BE
USED, REPRODUCED, PUBLISHED, OR
DISCLOSED TO OTHERS WITHOUT
WRITTEN CONSENT OF THE COMPANY.
IF LOANED, IT IS SUBJECT TO RETURN
UPON DEMAND AND MAY NOT BE USED
IN ANY WAY DIRECTLY OR INDIRECTLY
DETRIMENTAL TO THE COMPANY.

UNLESS OTHERWISE SPECIFIED
DIMENSIONS ARE IN INCHES
AND TOLERANCES ARE AS FOLLOWS:
TOLERANCE ON ANGLE: ±1°
2 PLACES: ±.01"
3 PLACES: ±.005"
INTERPRET DIMENSIONS AND TOLERANCES
PER ASME Y14.5M 1994 (R1999)

APPROVALS	DATE
DRWN K. Reid	10/10/02
CHKD D. Hutchins	10/10/02
APVD K. REID	10/10/2002

CONTRACT	SIZE	CAGE CODE	PART NO	DOCUMENT NO	REV
MATL N/A	C	OZ430	RPX_HM	9001932	C2
FINISH N/A	SCALE	NONE	DO NOT SCALE DRAWING	SHEET 1 OF 1	

APGH 1025 West 1700 North
Automation Products Group, Inc. Logan, Utah USA
888.525.7300

Hazardous Mounting Drawing
RPX Resistive Chain Probe
(RPX_HM)